


NOTE: THIS IS TO BE USED AS A GUIDE ONLY. THE MANUFACTURER RESERVES THE RIGHT TO AMEND SPECIFICATIONS WITHOUT PRIOR NOTICE



LEGEND

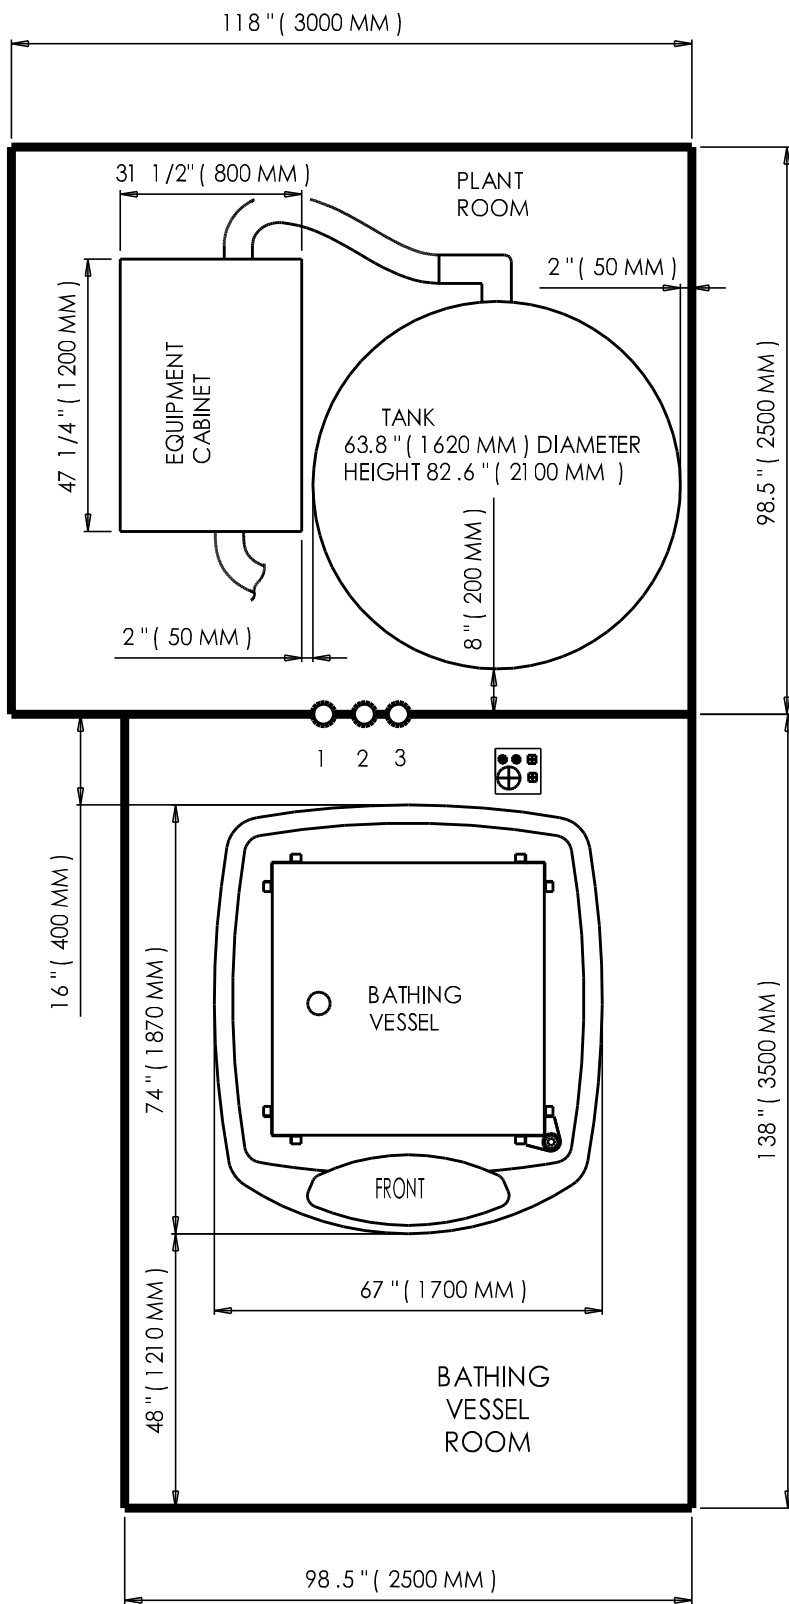

■ ELECTRICAL CABLES

• • HOT AND COLD WATER


⊕ DRAIN

- NOTE
- THE ELECTRICAL SUPPLY LINES CONNECT TO EQUIPMENT CABINET
 - DRAIN CONNECTS TO THE BOOTH AND THE OVERFLOW / BACKWASH FROM THE EQUIPMENT CABINET
 - COLD WATER SUPPLY LINE CONNECTS TO THE BOOTH AND TANK
 - ALL THE ABOVE ROUTED THROUGH WALL - HOLE 3

- ELECTRICAL
- 1 X 30 AMP DEDICATED 220 - 240 VOLT 50 / 60 Hz SUPPLY PROTECTED BY GFCI (EARTH LEAKAGE CIRCUIT BREAKER)
 - 1 X 10 AMP DEDICATED 100 / 120 OR 220 / 240 VOLT 50 / 60 Hz SUPPLY PROTECTED BY GFCI (EARTH LEAKAGE CIRCUIT BREAKER)

- PLUMBING
- 1/2" (12 MM) HOT AND COLD WATER SUPPLY 43.5 - 100 PSI (3 - 7 BAR)
 - DRAIN - 2" (50 MM TRAPPED DRAIN)

- NOTE - 4" (100 MM) HOLES THROUGH WALL MAXIMUM 1/2" (13 MM) ABOVE FLOOR
- 1 - SUCTION LINE
 - 2 - RETURN LINE
 - 3 - ELECTRIC CABLES AND PLUMBING LINES

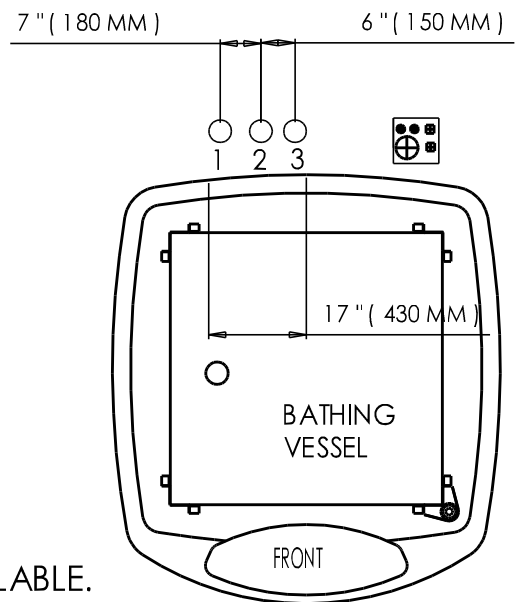

NOTE: OPTIONAL TANK SIZE / CONFIGURATION AVAILABLE.